



NDIR Infrared CO2 Gas Sensor

(Model: MH-410D)

Manual

Version: 2.8

Valid from: 2020.10.16

Zhengzhou Winsen Electronics Technology Co., Ltd

Statement

This manual copyright belongs to Zhengzhou Winsen Electronics Technology Co., LTD. Without the written permission, any part of this manual shall not be copied, translated, stored in database or retrieval system, also can't spread through electronic, copying, record ways.

Thanks for purchasing our product. In order to let customers use it better and reduce the faults caused by misuse, please read the manual carefully and operate it correctly in accordance with the instructions. If users disobey the terms or remove, disassemble, change the components inside of the sensor, we shall not be responsible for the loss.

The specific such as color, appearance, sizes &etc, please in kind prevail.

We are devoting ourselves to products development and technical innovation, so we reserve the right to improve the products without notice. Please confirm it is the valid version before using this manual. At the same time, users' comments on optimized using way are welcome.

Please keep the manual properly, in order to get help if you have questions during the usage in the future.

Zhengzhou Winsen Electronics Technology CO., LTD

MH-410D NDIR Infrared CO2 Sensor

Introduction

MH-410D infrared gas sensor is a miniature universal intelligent sensor, which adopts NDIR theory to detect concentration of CO₂ in air and has good selectivity, stable performance, long life, also is independent of Oxygen. The inside temperature sensor could be used for temperature compensation. This miniature infrared gas sensor is developed by the tight integration of mature infrared absorbing gas detection technology, micro machine workout and superior circuit design.



Features

- High sensitivity, high resolution, low power consumption, Fast response time
- Output method: UART, analog voltage signal
- Temperature compensation, excellent linear output
- Long lifespan, Excellent stability, Anti-poisons, anti-vapor interference

Applications

Widely used for HVAC refrigeration, industrial-process control and safety protection, agriculture and animal husbandry.

Main Parameters

Model	MH-410D
Detection Gas	CO ₂
Working Voltage	3.6~5V DC(Need to be powered by safety barrier)
Average Current	<85 mA
Interface Level	3.0V
Detection range	0-10%vol Optional(refer Fig2.)
Output Signal	UART
	0.4~2V(Need to be powered by safety barrier)
Warm-up time	3 min
Response time	T90<30s
Working Temperature	-20°C ~60°C
Working Humidity	0~95%RH(no condensation)
Sizes	Φ20x22.6mm
Weight	35g
Lifetime	>5 years
Defense Grade	IP54
Power, communication terminal Intrinsic safety	U _i =7.5VDC, I _i =265mA, P _i =0.5W, C _i =10 μF, L _i =0mH

Fig1






Fig2.Measuring Range and Resolution

Target Gas	Measuring Range	Accuracy	Note
CO2	0~2000 ppm	±(50ppm + 5% of Read Value)	Temperature compensation
	0~6000 ppm		Temperature compensation
	0~1% VOL		Temperature compensation
	0~3% VOL		Temperature compensation
	0~5%VOL		Temperature compensation

Structure Size

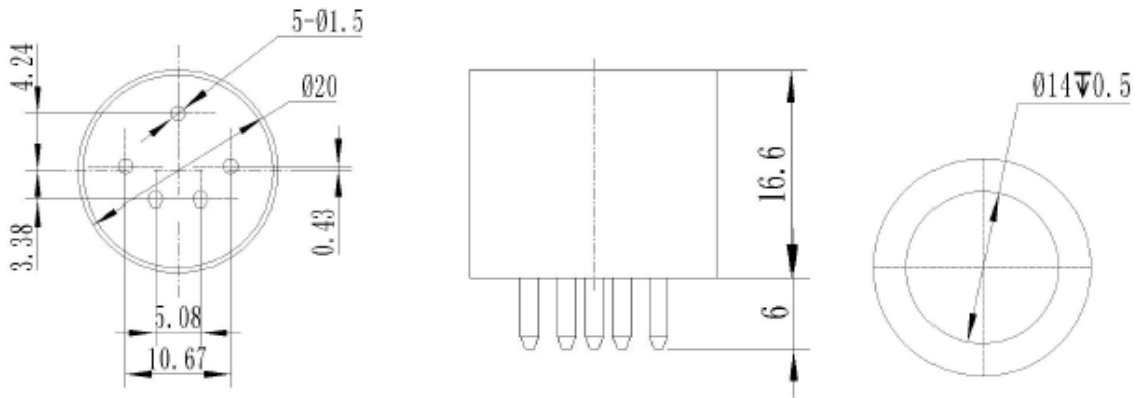


Picture 1.Sensor structure

■ **Pin definition**

Name of Pin	Explanation
Pin 2	Vin Voltage input
Pin 1	GND
Pin 4	Vout (0.4~2 V)
Pin 3	UART (RXD) 0~3.0 V data input
Pin 5	UART (TXD) 0~3.0 V data output


Fig3.Pin definition



Picture 2.Pin definition

Analog voltage output

The output of Vout is proportional to the gas concentration, 0.4-2.0V output stands for 0 to full range.
 Connection: Vin -5V,GND- Power Ground, Vout-ADC input.
 After warm-up, If self-checking detect a fault, output voltage is 0V.

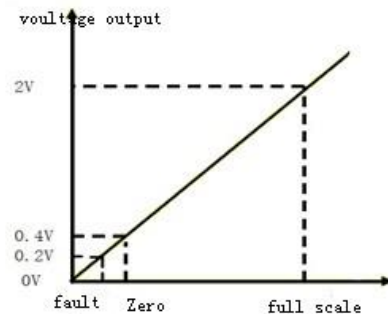

Digital Output


Please refer MH-410D communication protocol.

Intrinsically safe explosion-proof

- This product meets the standards of GB3836.1-2010 "Explosive Atmosphere Part 1: General Requirements for Equipment" and GB3836.4-2010 "Explosive Atmosphere Part 4: Equipment Protected by Intrinsically Safe "i" standards"; the explosion-proof mark is Exib II B T4 Gb, it is suitable for zone 1 and zone 2, contains Class IIA, T1-T3 explosive environment formed by the flammable gas, mixture of steam and air; it has passed the inspection by the National Quality Inspection Center for Explosion-proof Electrical Products and obtained the explosion-proof certificate. When using, please note the following:
- The intrinsically safe power supply must be used to power the sensor, otherwise the explosion-proof performance will be affected.
- It is forbidden to replace the sensor in dangerous places.
- It is forbidden to disassemble or replace the sensor element to avoid affecting the explosion-proof performance.
- It is not allowed to replace components or structures, so as not to affect the explosion-proof performance.
- The installation and wiring of the safety barrier must be carried out in accordance with the safety barrier instruction manual, and the safety barrier must obtain an explosion-proof certificate.

Connection diagram of intrinsically safe explosion-proof system

The on-site installation must comply with the relevant regulations of the GB3836.15—2000 "Electrical Equipment for Explosive Gas Environment Part 15: Electrical Installation in Hazardous Locations (Except Coal and Mines).

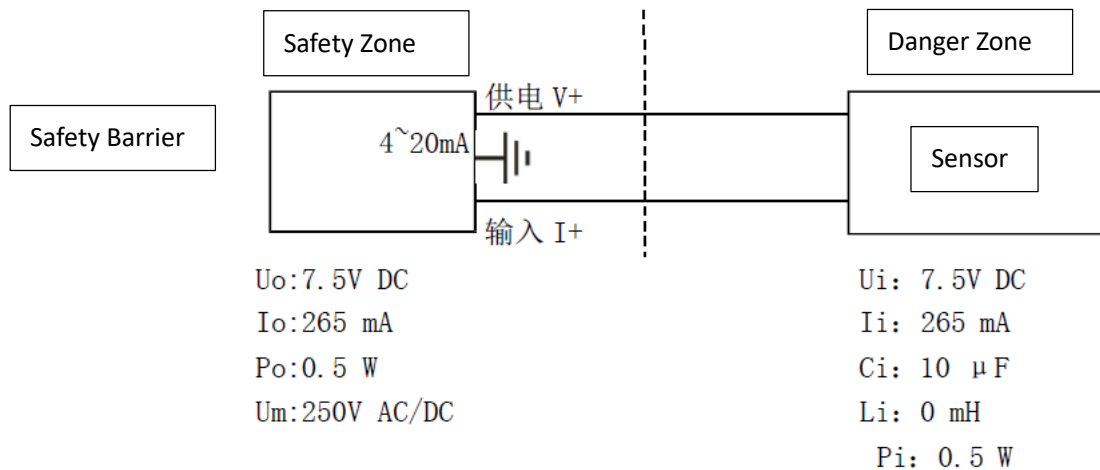

The distribution parameters of the connecting cable between the safety barrier and the sensor should meet:

$$C_c \leq C_o - C_i \quad L_c \leq L_o - L_i \quad U_i \geq U_o \quad I_i \geq I_o \quad P_i \geq P_o$$

Note:

U_o: Maximum output voltage of safety barrier;

I_o: Maximum output current of safety barrier

P_o: Maximum output power of safety barrier

C_o: Maximum external capacitance of safety barrier

L_o: the maximum external inductance of the safety barrier (see the safety barrier instructions for the above)

parameters book)

Cc: Maximum allowable distributed capacitance of connecting cable

Ui: sensor maximum input voltage

Ii: Maximum sensor input current

Pi: sensor maximum input power

Ci: Maximum internal capacitance of the sensor

Li: Maximum internal inductance of the sensor

Lc: Maximum allowable distributed inductance of connecting cable

Note:

- The sensor should be calibrated regularly, and the recommended calibration period is 6 months.
- Do not use the sensor for a long time in an environment with high dust density.
- Please use the sensor within the power supply range of the sensor.
- It is forbidden to cut or weld the sensor pins.

Zhengzhou Winsen Electronics Technology Co., Ltd

Add: No.299, Jinsuo Road, National Hi-Tech Zone,
Zhengzhou 450001 China

Tel: +86-371-67169097/67169670

Fax: +86-371-60932988

E-mail: sales@winsensor.com

Website: www.winsen-sensor.com